

LEGEND:
 20FL - 20 FT MINIMUM FIRE LANE
 30FL - 30 FT MINIMUM FIRE LANE
 ALL GATES WILL BE INSTALLED WITH A KNOX BOX FOR RAPID ENTRY

PRIMARY FIRE ACCESS
 SNOWDOWN E.V.A.
 WIDTH: 20 FT
 # OF TURNOUTS: PER CODE
 TYPE OF MATERIAL: ROCK TO SUPPORT FIRE TRUCK

SECONDARY FIRE ACCESS
 PROPOSED 14' PAVED MAINTENANCE ROAD
 TYPE OF MATERIAL: AC PAVEMENT

PROPOSED PUMP HOUSE
 PERFESS TYPE PUMPING SYSTEM NPPA 24 COMPLIANT PRESSURIZED SYSTEM. NO STORAGE TANK REQUIRED ON CALIFORNIA EXHIBIT.

PROPOSED 12" FIRE & 4" DOMESTIC WATER SERVICE

CONNECTION 2

EXISTING 16" WATER LINE

PROPOSED GATE

PROPOSED VETERINARY MEDICAL HOSPITAL

PROPOSED GATE

FENCE LINE

FIRE HYDRANT


FIRE HYDRANT

FIRE HYDRANT

PROPOSED GATE

SNOWDOWN E.V.A.

R=40'

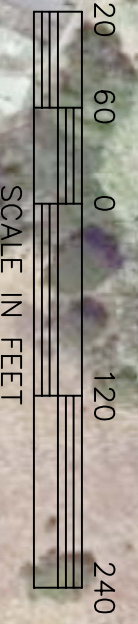


PRELIMINARY
 NOT FOR CONSTRUCTION

JOB NO	208022
SCALE	1"=120'
DATE	6/15/2010
DESIGN	
DRAWN	MC
APPROVED	

FIRE SERVICE PLAN
CALIFORNIA EXHIBIT - CUP CM09085 - OAKLAND ZOO

OAKLAND ALAMEDA COUNTY CALIFORNIA

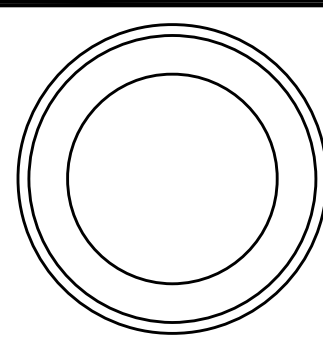

No.	BY	DATE	REVISIONS

ALIQUOT
 PLANNERS
 CIVIL ENGINEERS
 SURVEYORS

ALIQUOT ASSOCIATES, INC.
 400 BOULEVARD WAY - 2ND
 OAKLAND, CA 94610
 (510) 601-5101
 FAX: (510) 601-5171